


Backflow Device	A
4"	6' 3"
6"	9'
8"	11' 2"

Water Main Size	B
6"	17"
8"	19"
12"	22"
16"	26"
24"	32"

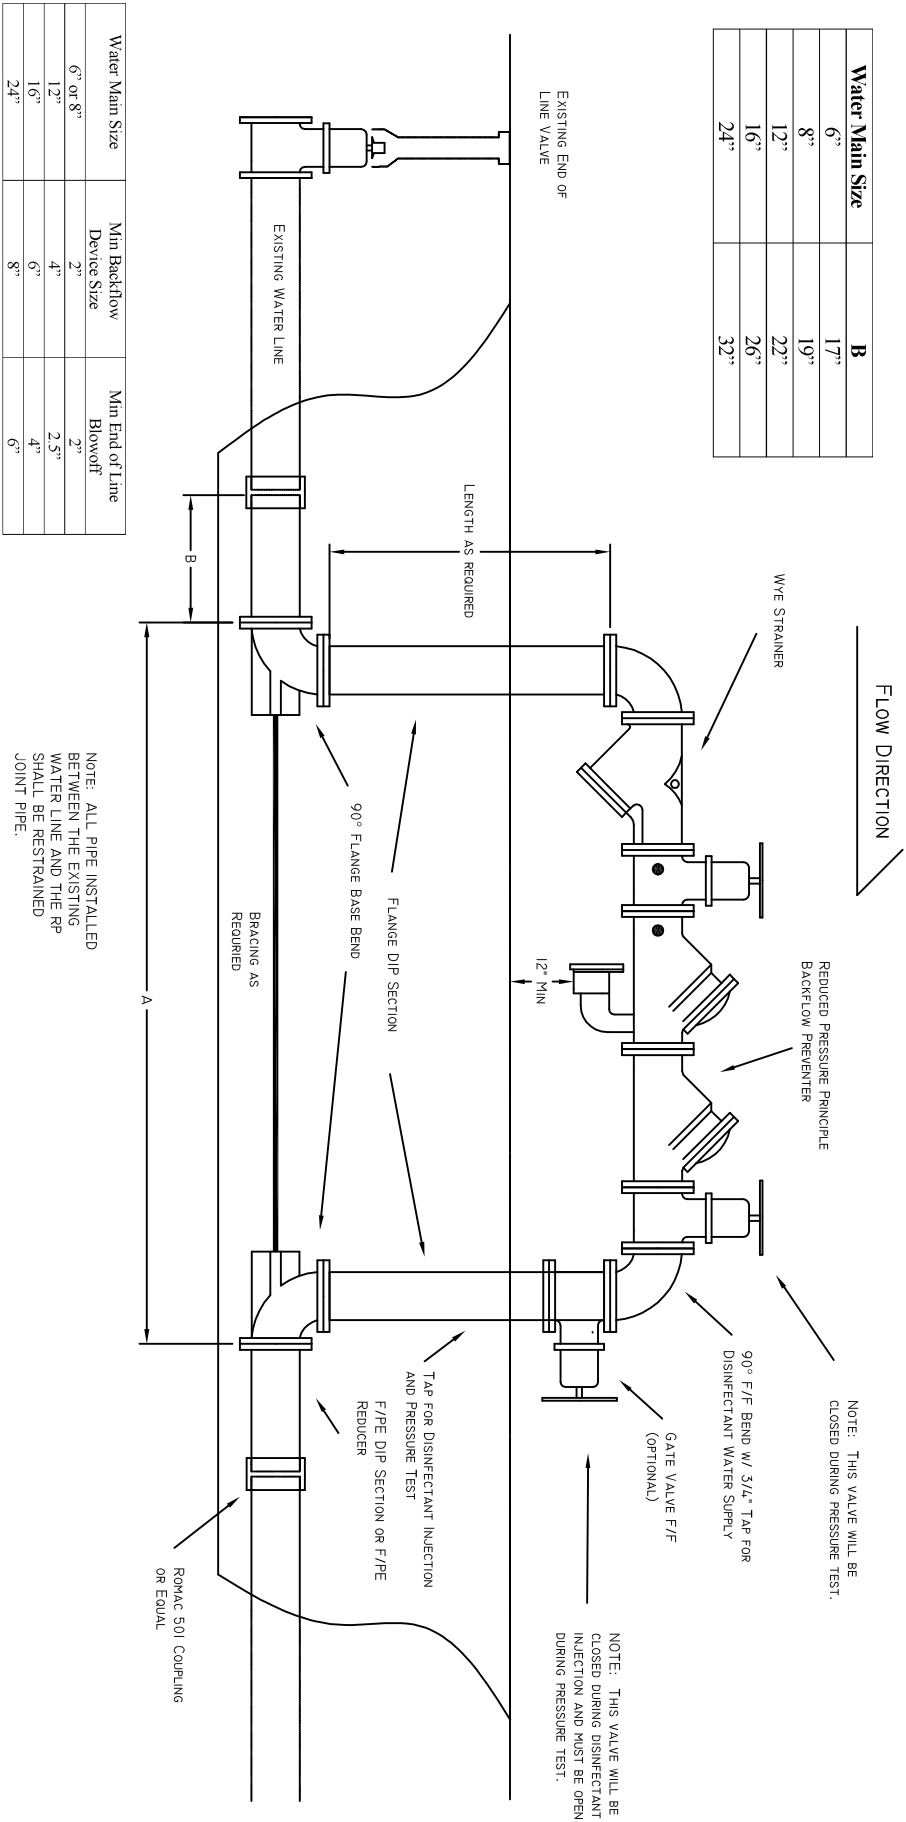

CITY OF SALISBURY, N.C. STANDARD DETAIL

DATE: OCTOBER 17, 2006

BY-PASS BACKFLOW PREVENTION DEVICE
FOR FILLING NEW LINES

NOT TO SCALE

STANDARD

W-13